

# **A Review of Advances in Geothermal Heating and Cooling Systems**

**\*Er. Umesh Kumar Sahoo, \*\*Er. Chittaranjan Routray**

\*Department of Mechanical Engineering, Swami Vivekananda School of Engineering & Technology, Chaitanya Prasad, Madanpur, Bhubaneswar, Khordha-752054,  
Email id- [er.umesh.sahoo@gmail.com](mailto:er.umesh.sahoo@gmail.com)

\*\*Department of Mechanical Engineering, Swami Vivekananda School of Engineering & Technology, Chaitanya Prasad, Madanpur, Bhubaneswar, Khordha-752054,  
Email id- [svset.principal08@gmail.com](mailto:svset.principal08@gmail.com)


## **ABSTRACT**

Rising energy demand and the depletion of fossil fuels have driven the exploration of new frontiers in renewable energy technology. Geothermal heating and cooling is a new advancement in the Indian HVAC industry. It uses the earth's heat to heat and cool spaces with the use of heat pump systems, saving up to 51% on HVAC electricity consumption and reducing CO<sub>2</sub> emissions. The main prospects for geothermal energy are longer equipment life and lower operating costs. This article reviews recent advances in geothermal heating and cooling systems.

**Keywords:** Geothermal, heat pump, ground loop, air handling unit (AHU), heating, cooling, ground source heat pump system (GSPH's)

## **INTRODUCTION**

Previously, the air conditioning system was considered a symbol of luxury. Now that the world is growing faster, it has become a need of the day. The residential and commercial sector contributes to more than 30% of the total electricity consumption [1]. Of this, the HVAC system consumes 64% of the electricity. As the need for HVAC increases, so does the demand for energy. Therefore, fossil fuels are used on a large scale to meet this requirement, increasing CO<sub>2</sub> and particulate matter emissions, leading to global warming. This has paved the way for renewable energy sources and the viability of “geothermal heating and cooling” [2]. The name geothermal is derived from the words "Geo" means earth and "Thermal" means heat. The Earth's heat is produced by gravitational collapse and the radioactive decay of isotopes. The soil provides a stable temperature at approximately 6 to 8 m in the range of 16 to 29 °C throughout the year [1]. The geothermal system is also called "geothermal heat pump (GHP) system, ground source heat pump (GSPH) system or geothermal exchange system, and works on the basic principle of stable temperature heat pump of the land to provide heating and cooling. Ground loops are used to connect ground and space for heating or cooling applications (Figure 1)

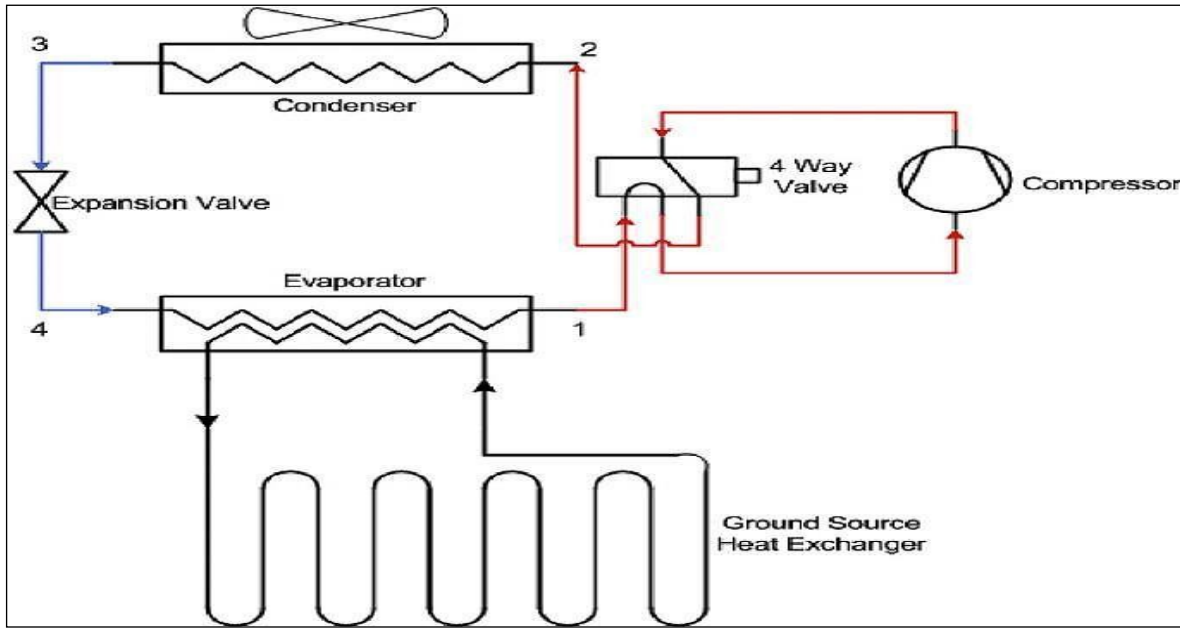

**Fig. 1:** Schematic Diagram of Geothermal Heating and Cooling System.

## COMPONENTS OF GSPH'S

Geothermal Grounding System The geothermal grounding system connects the space to be cooled or heated to the ground using copper pipes (high thermal conductivity) or high-density polyethylene (HDPE). The thermal conductivity of copper is 380 W/mK, while the thermal conductivity of HDPE pipes is 0.42 to 0.51 W/mK. The diameter of the pipe ranges from 29 to 38 mm [3]. As pipe length increases, the overall efficiency of the system also increases, with the required pipe length depending primarily on geographic and building character. There are two types of GSPH system:

### OPEN LOOP


There are two wells, one to drink water and another to impoverish the water. Water is injected from the first well to extract or reject heat as per requirement and then expelled to the second well. The water requirement is 5.67–7.57 lpm per ton (Figure 2) [4]. The main drawback of this system is the quality of the water, which affects the useful life of the components and increases maintenance costs. Additionally, local environmental regulations may be restrictive.

### CLOSED LOOP

In a closed loop system, water recirculates through the coil forming a closed loop. The water quality can be regulated and an antifreeze mixture (e.g. methyl alcohol) can be added to prevent freezing. The closed loop system is further classified into:


**HORIZONTAL LOOP:**

Horizontal loops are typically found between 1 and 2 m depth [5]. If more land is available, a horizontal circuit can be used. After the installation of this system, we cannot use this land for any other use; therefore, there is tied capital in this system (Figure 3). Furthermore, the soil temperature varies from pitch to pitch and there is no constant temperature. Horizontal loops require approximately 232 m<sup>2</sup>/t of area, but are easy to install

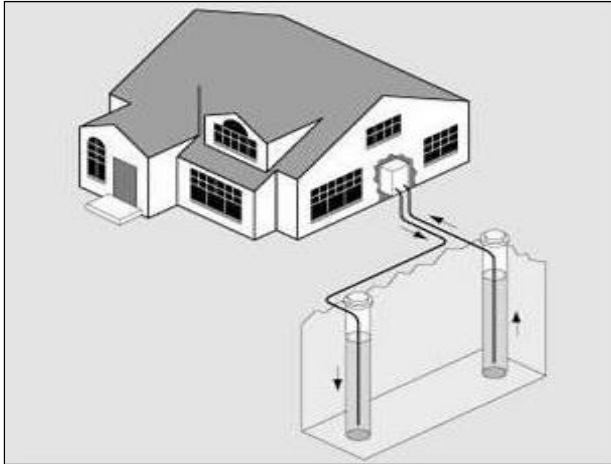

and less expensive [6].


*Fig. 2: Open Loop System-Schematic.*

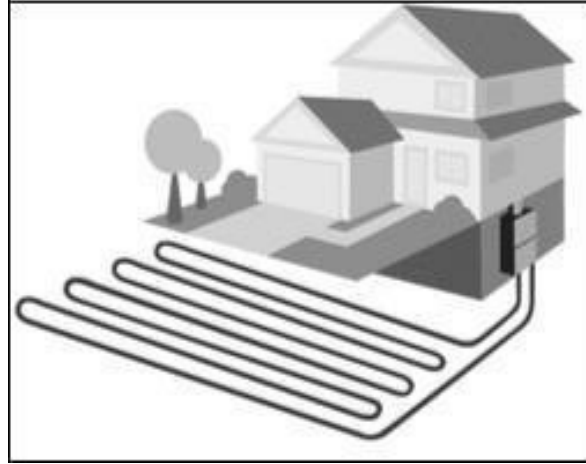

*Fig. 3: Horizontal Loop.*

**VERTICAL LOOP:**

Holes are drilled into the ground. The spacing between two wells is at least 5 to 6 m (Figure 4). This type of system requires between 23 and 27 m<sup>2</sup>/t of surface [6]. The installation cost, being a function of the depth of the pipe and the geology of the location, is greater than the horizontal cost. The advantages of the vertical loop are; lower space requirement, lower variations due to temperature and thermal properties of the soil and higher efficiency [3].

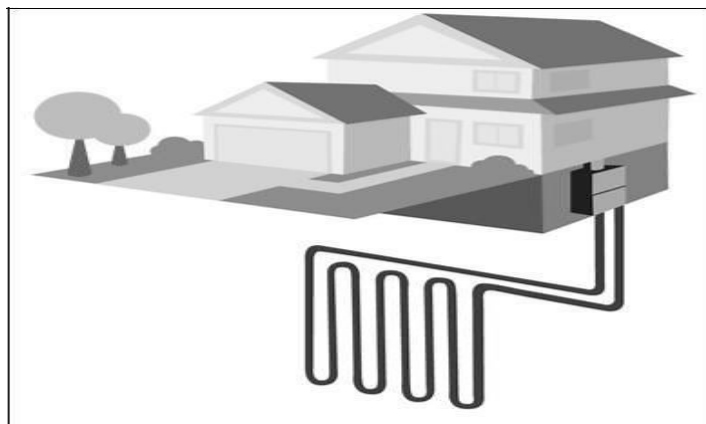

*Fig. 4: Vertical Loop System.*

**GEOHERMAL HEAT PUMP SYSTEM**

The heat pump system consists of a compressor, condenser, expansion valve and evaporator and is governed by the second law of thermodynamics. It raises the temperature of the vapor by isentropic compression [7]. The cooling effect is produced by expanding the compressed vapor in the expansion valve and lowering its temperature. In summer it acts as a refrigerator. The heat pump does not generate heat but rather transfers heat from a lower temperature to a higher temperature. The heat pump converts 1 KW of electricity into 3 KW of useful work [8]. Therefore, the COP of a heat pump is higher than that of a refrigerator. A heat pump has an average life of +20 years [9].

**GEOHERMAL HEAT DISTRIBUTION SYSTEM**


It consists of an air handling unit (AHU). This supplies air at the required temperature to the space whose temperature must be maintained. Ducts are provided to supply the required air [5].

**GEOHERMAL HEAT PUMP SYSTEM OPERATION WORKING**

❖ **Heating mode**

In winter, when heating is needed in the room, the water in the ground loop absorbs heat from the ground and thus increases the temperature of the water in the pipe. The expanded vapor coolant circulates inside the heat-conducting copper pipes, and because the coolant absorbs heat from the ground loop water, its temperature increases. This refrigerant vapor is further sent to the compressor where it is compressed at high pressure and temperature.

Hot refrigerant vapor passes from the copper coil of the air handling unit (AHU). Cold air from the house is passed through this copper coil by a fan or blower, absorbing heat from the hot refrigerant vapor and warming the room.

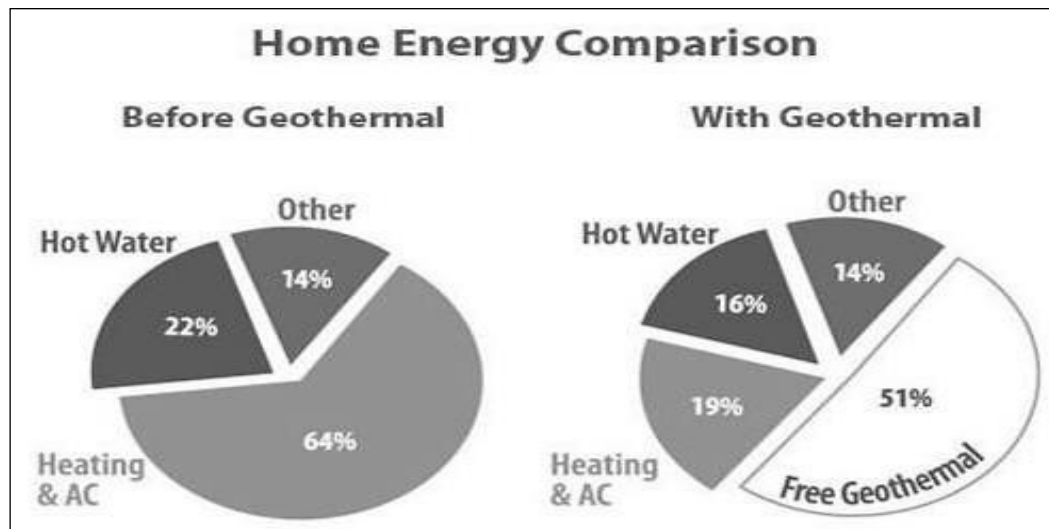

**Fig. 5:** Energy Savings by GSHP's.

## ❖ COOLING MODE

In cooling mode, operational reversal of heating mode occurs. The water in the circuit rejects its heat to the earth and the temperature of the water decreases. The hot refrigerant from the compressor rejects its heat to the groundwater and the temperature of the refrigerant vapor decreases. After this, the refrigerant vapor expands in the expansion valve, further reducing its temperature. This cold refrigerant then circulates in the copper coil of the AHU [13-18].

Hot air from the room passes through the cold refrigerant coil, where the hot air rejects heat. Now this cold air reaches the room. The hot refrigerant is returned to the compressor, where it is compressed at high temperature and pressure, and the entire cycle is repeated. Additionally, with space heating and cooling, we can obtain hot water by installing a super-heater in the system.

## COMPARISON & ADVANTAGES

From Figure 5 it is observed that 51% of the energy is free and the energy needed for heating and air conditioning, and water heating has also been reduced. The heat pump has greater efficiency and also this system does not depend on the outside temperature, as in the case of the traditional HVAC system [10]. Lower maintenance and operation costs; since the heat pump system is installed inside the house, protecting it from harsh weather and climate conditions [10]. It also requires 50% less energy. The Ministry of New and Renewable Energy (MNRE) in New Delhi, in a bid to boost the use of renewable sources and reduce carbon footprint, is providing loans, tax credit concessions and many more incentives. Water conservation is 100% due to the replacement of the chiller with ground circuits and also the low cost of water heating [11]. Geothermal heating and cooling is environmentally friendly as it saves a large amount of CO<sub>2</sub>.

## CONCLUSION

The growth of this technology is slower than that of other RES technologies due to the high installation cost and limited knowledge of geothermal technology and its collection means [12].

## REFERENCES

1. Draft National Policy on Geothermal Energy. Delhi: Government of India, Ministry of New and Renewable Energy.
2. Rahul Vadhari, Hiren Prajapati. Geothermal Air-conditioning. International Journal of Engg. Science and Research Technology (IJESRT).
3. ASHRAE Handbook-1999. HVAC Application. Energy Related Application. Chapter 31, Geothermal Energy.

4. Klaassen Curtis J. Geothermal Heat Pump System. Iowa Energy Centre, Energy Resource Station.
5. Domestic Ground Source Heat Pump. Design and Installation of Closed Loop System (2007 Edn., Introduction System and Application).
6. Momin Gaffara G. Experimental Investigation of Geothermal Air- conditioning. American Journal of Engineering Research (AJER). 2013.
7. Earth to Air System (ETA). ETA Geothermal Technology: Basic Operating Overview. [www.earthtoair.com](http://www.earthtoair.com)
8. Robin Curtis, Kapil JC, et al. A First for India: 100 KW Borehole Based Geothermal Heat Pump System for Space Heating in Himalayas. Proceedings World Geothermal Congress 2015. Melbourne, Australia. 19–25 Apr 2015.
9. US Dept. of Energy. Energy, Efficiency and Renewable Energy. [www.energysavers.gov](http://www.energysavers.gov).
10. Geothermal India. [www.geothermalindia.com](http://www.geothermalindia.com)
11. Grant Morrison, Parwer Ahmed. Geothermal HVAC Exceeding ASHRAE Standards at Lowest Life Cycle Cost. Air Conditioning and Refrigeration Journal. Jan–Mar 2011.
12. Belf ST, Reddy BV, Rosen MA. Geothermal Pump System Status Review & Comparison with Other Heating Option. Appl Energy. 2013; 101: 341–348p.
13. Silva Cocchi, Sonia Castellucci. Modelling of an Air-conditioning System with Geothermal Heat Pump for Residential Building. Math Probl Eng. 2013.
14. Lund JW, Frestones DH, Boyd JL. Direction Application Geothermal Energy: Worldwide Review. Geothermal. 2005; 34(6): 691–727p.